



[I-21/67/2025-W&M Section]

GOVERNMENT OF INDIA/भारत सरकार

MINISTRY OF CONSUMER AFFAIRS, FOOD AND PUBLIC DISTRIBUTION

उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय

DEPARTMENT OF CONSUMER AFFAIRS/ उपभोक्ता मामले विभाग

LEGAL METROLOGY DIVISION/ विधिक मापविज्ञान प्रभाग

Krishi Bhawan/कृषि भवन, नई दिल्ली

Dated/दिनांक:- 20 .03.2025

Certificate of Approval of Model/ मॉडल का अनुमोदन प्रमाणपत्र


Whereas the Central Government, after considering the report submitted to it by prescribed authority, is satisfied that the model described in the said report (see the figure given below) is in conformity with the provisions of the Legal Metrology Act, 2009 (1 of 2010) and the Legal Metrology (Approval of Models) Rules, 2011 and the said model is likely to maintain its accuracy over periods of sustained use and to render accurate service under varied conditions;

Now, therefore, in exercise of the powers conferred by section 22 of the Legal Metrology Act, 2009 (1 of 2010) read with sub-rule (6) of rule 8 and sub-rule (4) of rule 11 of the Legal Metrology (Approval of Models) Rules, 2011, as per Schedule Seventh of the Legal Metrology (General) Rules, 2011, the Central Government hereby issues the certificate of approval of automatic gravimetric filling instrument belonging to accuracy class X(x), where x=1 of series "ABPA" and with brand name "APIT" (hereinafter referred to as the said model), manufactured by M/s. APIT Machinery Pvt. Ltd No.164&165, Kiadb Industrial Are Obadenahalli, Doddaballapur Taluk, Bengaluru Rural District, Bengaluru-561203, Karnataka and which is assigned the approval mark IND/09/25/ 88 (the picture of the model is given below as Figure 1);

Technical Data:

| | |
|--------------------------|---|
| Type of instrument | Automatic gravimetric filling instrument(Single head grain blending & filling machine) |
| Working Principle | Electronics and bending beam load cell based |
| Accuracy class | X(1) |
| Maximum Filling capacity | 50kg |
| Minimum filling capacity | 5 kg |
| Scale interval (d) | 5 g |
| No. of Weighing Units | 1 |
| Filing speed | Approx. 4 to 7 fills per minute |
| No of filling head | 1 |
| Power Supply | 230 V, 50Hz AC |
| Load Cell | Make: Vishay Precision Group;Model: 35; Capacity:100kg ; Accuracy Class:C3 |
| Display | LED |
| Intended to be used | Rice milling and other food grain processing industry to fill known mass of free-flowing materials like rice and other food grain |

Figure 1

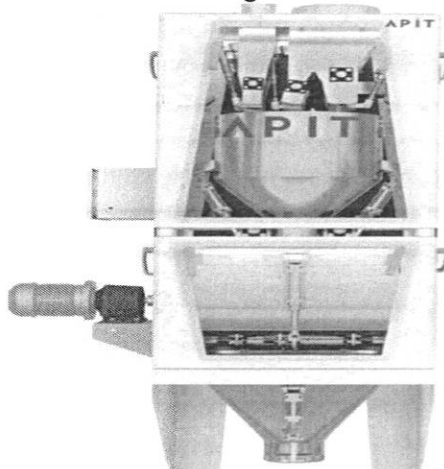



SEALING DIAGRAM & LOCATION OF DIP SWITCH

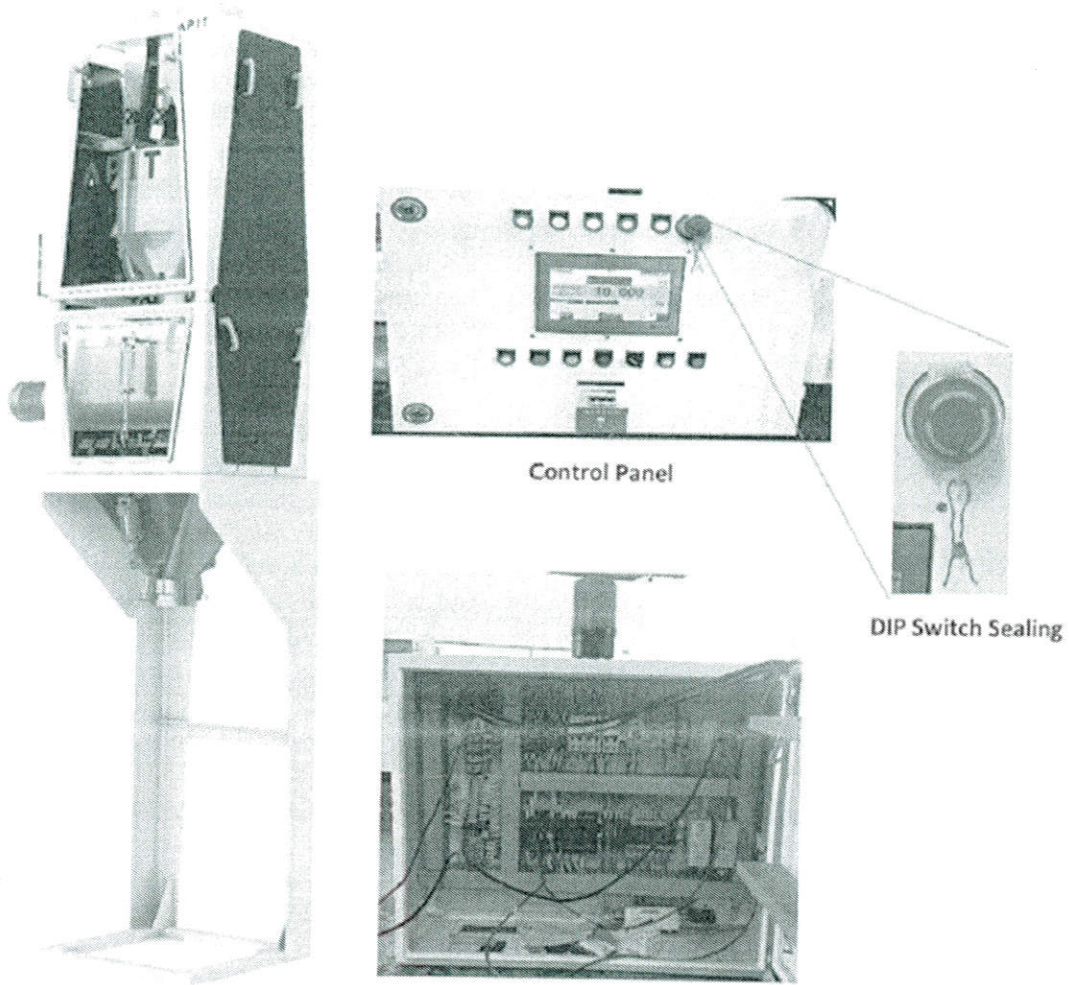


Figure 2

A typical schematic diagram of sealing provision to prevent the fraudulent practices of the model is given above as Figure 2. A dip switch has also been provided in the motherboard/PCB to disable access to external calibration.

Further, in exercise of the power conferred by sub-rule (9) of rule 8 of the Legal Metrology (Approval of Models) Rules, 2011, the Central Government hereby declares that this certificate of approval of the said model shall also cover the automatic gravimetric filling instruments of similar make, accuracy and performance of same series with capacity from 5 kg and up to 50 kg manufactured by the same manufacturer in accordance with the same principle, design and with the same materials with which, the said approved model has been manufactured.

[F.No. I-21/67/2025-W&M Section]

(Ashutosh Agarwal)

Director (Legal Metrology) to Govt. of India/ निदेशक (विधिक माप विज्ञान) भारत सरकार

Phone/दूरभाष 01123389489

Email/ई-मेल: dirwm-ca@nic.in

Online Application No. 22051