



Online application no. 24197

[I-21/194/2026-W&M Section]

GOVERNMENT OF INDIA/भारत सरकार
MINISTRY OF CONSUMER AFFAIRS, FOOD AND PUBLIC DISTRIBUTION
उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय
DEPARTMENT OF CONSUMER AFFAIRS/ उपभोक्ता मामले विभाग
LEGAL METROLOGY DIVISION/ विधिक मापविज्ञान प्रभाग

Krishi Bhawan/कृषि भवन, नई दिल्ली

Dated/दिनांक:- 06. 07..2026

Certificate of Approval of Model/ मॉडल का अनुमोदन प्रमाणपत्र

Whereas the Central Government, after considering the report submitted to it by the prescribed authority along with the EU type examination certificate no.-I-2142-MI002-TG005 Rev. 10 issued by Tifernogas s.r.l., Italy is satisfied that the model described in the said report (see the figure given below), is in conformity with the provisions of the Legal Metrology Act 2009 (1 of 2010) and the Legal Metrology (Approval of Models) Rules, 2011 and the said model is likely to maintain its accuracy over periods of sustained use and to render accurate service under varied conditions;

Now, therefore, in exercise of the powers conferred by section 22 of the Legal Metrology Act, 2009 (1 of 2010) read with sub-rule (6) of rule 8 and sub-rule (4) of rule 11 of the Legal Metrology (Approval of Models) Rules, 2011, the Central Government hereby issues the certificate of approval of the model of Diaphragm gas meter, Type: “MM10”; “MM10-M16-SV”; “MM16”; “MM16FL” & “MM16-M25-SV” of accuracy class: 1.5 (hereinafter referred to as the said model), manufactured by M/s Pietro Fiorentini s.p.a Via Enrico Fermi 8/10, 36057 Arcugnano (VI) Italy and imported & marketed in India without any alteration before or after sale by M/s Pietro Fiorentini Db India Private Limited, Gat No. 43, Navlakh Umbre, Talegaon, MIDC, Taluka Maval, Pune, Maharashtra-410507 and which is assigned the approval mark IND/09/26/ 319 (the picture of the model is given below as Figure 1);

Valid until: 21.12.2026

Figure 1



Model MM10



Model MM10-MM16-SV



Model MM16



Model MM16FL







Model MM16-M25-SV



Technical Data:

Types	Accuracy Class	1.5
MM10 MM10-M16-SV	Environmental Class	M1/E2
	Maximum Flow rate Q_{max}	16 m ³ /h
	Minimum Flow rate Q_{min}	0.1 m ³ /h
	Flow rate Q_t	1.6 m ³ /h
	Cyclic volume	6 dm ³
	High Temperature, "T"	Yes
	Ambient Temperature Range t_m	-25 °C to +55 °C
	Gas Temperature t_g	-25 °C to +55 °C
	Maximum Pressure	0.5 bar
	Shut off valve	Yes (only for MM10-M16-SV)

Types	Accuracy Class	1.5
MM16 MM16FL-M16- M25-SV	Environmental Class	M1/E2
	Maximum Flow rate Q_{max}	25 m ³ /h
	Minimum Flow rate Q_{min}	0.16 m ³ /h
	Flow rate Q_t	2.5 m ³ /h
	Cyclic volume	6 dm ³
	High Temperature, "T"	Yes
	Ambient Temperature Range t_m	-25 °C to +55 °C
	Gas Temperature t_g	-25 °C to +55 °C
	Maximum Pressure	0.5 bar
	Shut off valve	Yes (only for MM16-M25-SV)

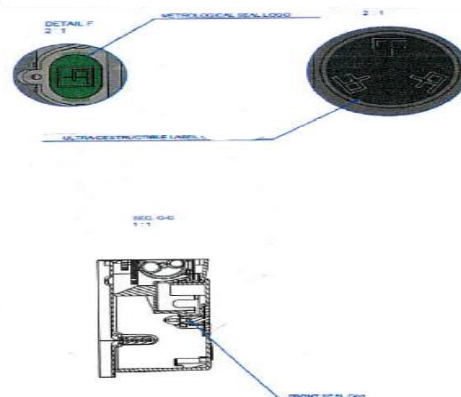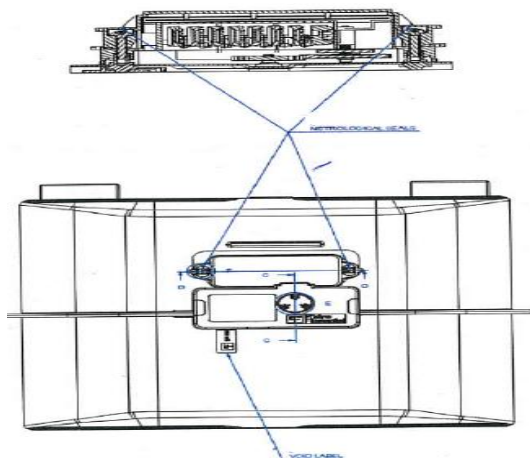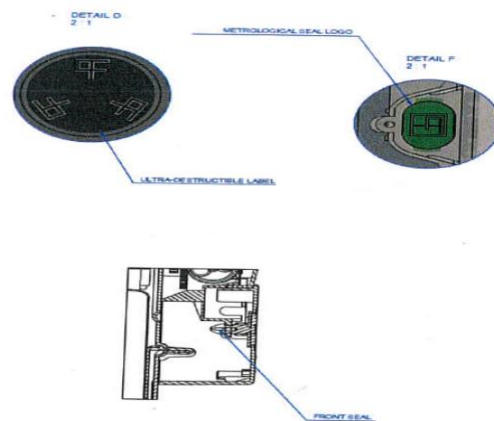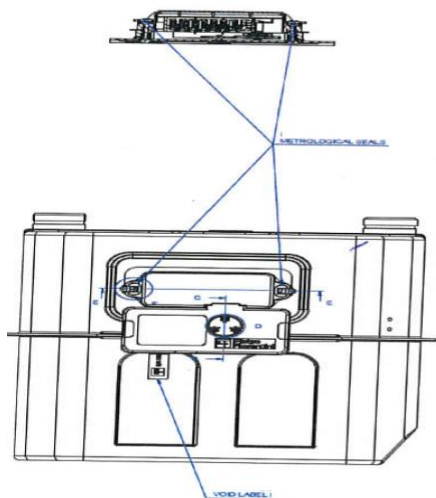

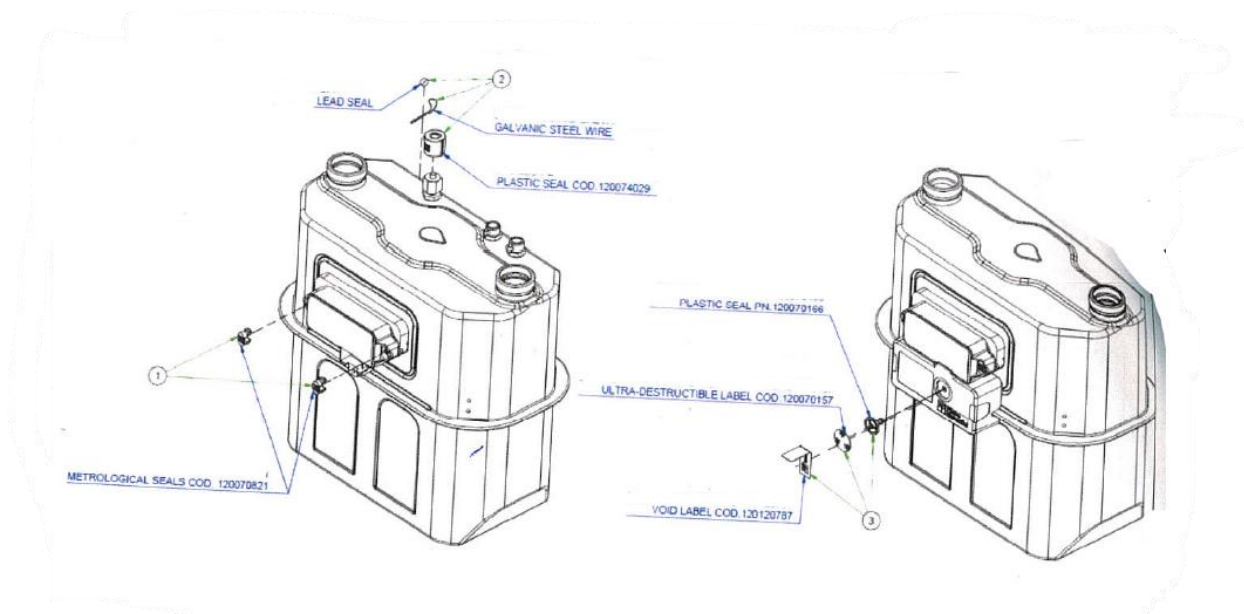


Figure-2

A typical schematic diagram of sealing provision to prevent the fraudulent practices of the model is given above as Figure 2.

[F.No.I-21/194/2026-W&M Section]



(Ashutosh Agarwal/आशुतोष अग्रवाल)
Director (Legal Metrology) to Govt. of India/ निदेशक (विधिक माप विज्ञान) भारत सरकार
Phone/दूरभाष 011-23389489
Email/ई-मेल: dirwm-ca@nic.in