



Online Application No. 24131

[I-21/242/2026-W&M Section]

GOVERNMENT OF INDIA/भारत सरकार
MINISTRY OF CONSUMER AFFAIRS, FOOD AND PUBLIC DISTRIBUTION
उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय
DEPARTMENT OF CONSUMER AFFAIRS/ उपभोक्ता मामले विभाग
LEGAL METROLOGY DIVISION/ विधिक मापविज्ञान प्रभाग

Krishi Bhawan/कृषि भवन, नई दिल्ली

Dated/दिनांक:- 18.08.2026

Certificate of Approval of Model/ मॉडल का अनुमोदन प्रमाणपत्र

Whereas the Central Government, after considering the report submitted to it by prescribed authority, is satisfied that the model described in the said report (see the figure given below) is in conformity with the provisions of the Legal Metrology Act, 2009 (1 of 2010) and the Legal Metrology (Approval of Models) Rules, 2011 and the said model is likely to maintain its accuracy over periods of sustained use and to render accurate service under varied conditions;

Now, therefore, in exercise of the powers conferred by section 22 of the Legal Metrology Act, 2009 (1 of 2010) read with sub-rule (6) of rule 8 and sub-rule (4) of rule 11 of the Legal Metrology (Approval of Models) Rules, 2011, as per Schedule Seventh of the Legal Metrology (General) Rules, 2011, the Central Government hereby issues the certificate of approval of model of automatic gravimetric filling instrument belonging to accuracy class X(x), where $x=1$ of series "ABPB" and with brand name "APIT" (hereinafter referred to as the said model), manufactured by M/s. APIT Machinery Pvt. Ltd No.164&165, Kiadb Industrial Area Obadenahalli, Doddaballapur Taluk, Bengaluru Rural District, Bengaluru-561203, Karnataka and which is assigned the approval mark IND/09/26/404 (the picture of the model is given below as Figure 1);

Technical Data:

Type of instrument	Automatic gravimetric filling instrument (Twin grain blending & filling machine)
Working Principle	Electronics and load cell based
Accuracy class	X(x) where $x=1$
Maximum capacity	50kg
Minimum capacity	5 kg
Scale interval (d)	5 g
No. of Weighing Units	2
Filling speed	8 to 14 fills per minute (50 kg packets 08 Nos. per minute & 5 kg packets 14 Nos. per minute)
No of filling head	01
Power Supply	230 V, 50Hz AC and 24 V DC
Load Cell	Make: Vishay Precision Group, Teda Huntleigh; Model:0355; Max.Capacity:100kg each ; Accuracy Class:C3
Display	LCD
Software Details	Software version: 2.3 ; Checksum: 3.2.0
Material to be filled	Free flowing materials like rice, pulses and other food grains etc.

Figure 1



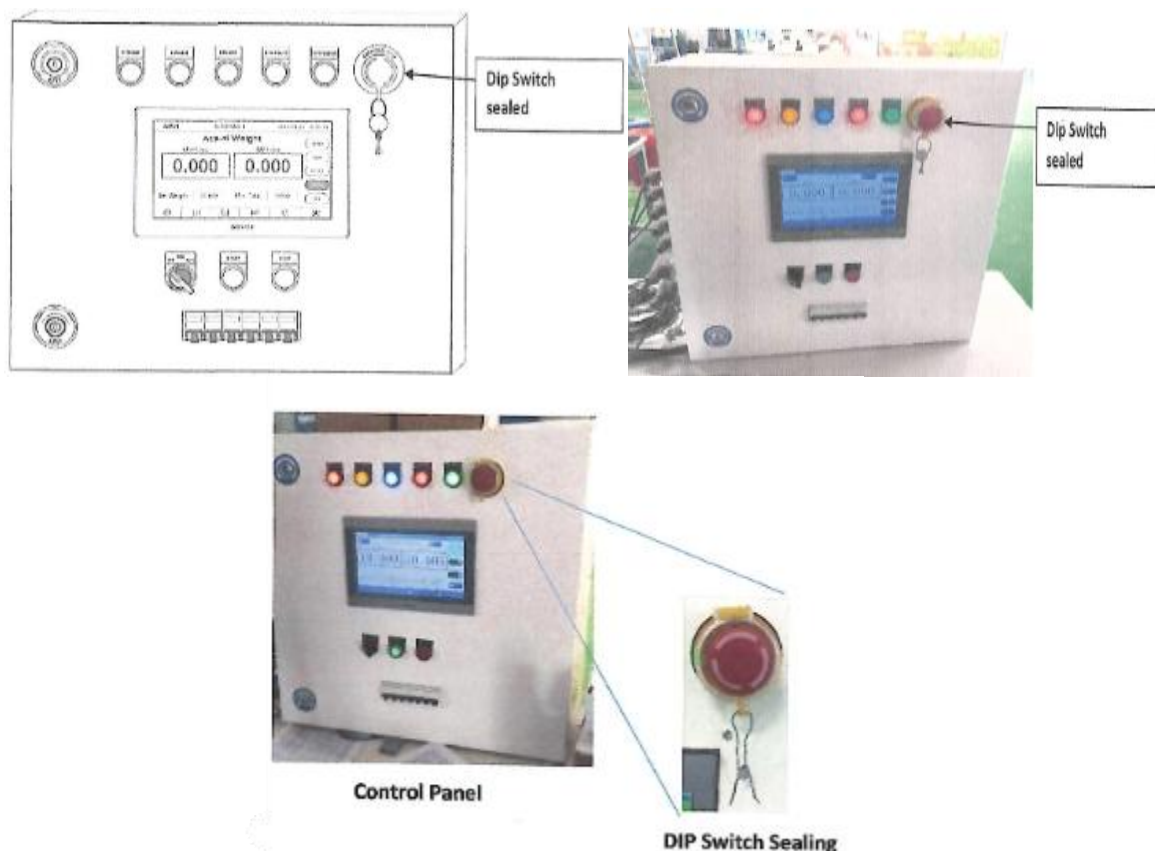


Figure 2

A typical schematic diagram of sealing provision to prevent the fraudulent practices of the model is given above as Figure 2. A dip switch has also been provided in the motherboard/PCB to disable access to external calibration.

Further, in exercise of the power conferred by sub-rule (9) of rule 8 of the Legal Metrology (Approval of Models) Rules, 2011, the Central Government hereby declares that this certificate of approval of the said model shall also cover the automatic gravimetric filling instruments of similar make, accuracy and performance of same series with capacities from 2kg and up to 30kg with 02 nos of filling heads and with filling speed of 2 to 6 fills per minute, manufactured by the same manufacturer in accordance with the same principle, design and with the same materials with which, the said approved model has been manufactured.

[F.No. I-21/242/2026-W&M Section]



(Ashutosh Agarwal/आशुतोष अग्रवाल)
Director (Legal Metrology) to Govt. of India/ निदेशक (विधिक माप विज्ञान) भारत सरकार
Phone/दूरभाष 011- 23389489
Email/ई-मेल: dirwm-ca@nic.in