



Online Application No. 23870

[I-21/294/2026-W&M Section]

GOVERNMENT OF INDIA/भारत सरकार
MINISTRY OF CONSUMER AFFAIRS, FOOD AND PUBLIC DISTRIBUTION
उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय
DEPARTMENT OF CONSUMER AFFAIRS/ उपभोक्ता मामले विभाग
LEGAL METROLOGY DIVISION/ विधिक मापविज्ञान प्रभाग

Krishi Bhawan/कृषि भवन, नई दिल्ली
Dated/दिनांक:- 28.09.2026

Certificate of Approval of Model/ मॉडल का अनुमोदन प्रमाणपत्र

Whereas the Central Government, after considering the report submitted to it by prescribed authority, is satisfied that the model described in the said report (see the figure given below) is in conformity with the provisions of the Legal Metrology Act, 2009 (1 of 2010) and the Legal Metrology (Approval of Models) Rules, 2011 and the said model is likely to maintain its accuracy over periods of sustained use and to render accurate service under varied conditions;

Now, therefore, in exercise of the powers conferred by section 22 of the Legal Metrology Act, 2009 (1 of 2010) read with sub-rule (6) of rule 8 and sub-rule (4) of rule 11 of the Legal Metrology (Approval of Models) Rules, 2011, as per Schedule Seventh of the Legal Metrology (General) Rules, 2011, the Central Government hereby issues the certificate of approval of model of automatic gravimetric filling instrument belonging to accuracy class X(x), where $x=1$ of series "CCW-RVP" and with brand name "ISHIDA" (hereinafter referred to as the said model), manufactured by M/s Ishida Co., Ltd., #44, Sanyo-Cho, Shogoin, Sakyo-Ku, Kyoto, 606-8392, Japan and imported and marketed in India without any alteration by M/s Ishida India Private Limited, Plot No: B-4, MIDC Khandala, Phase-2 Industrial Area, Village-Kesurdi, Taluka-I, Pune-41280, Maharashtra which is assigned the approval mark IND/09/26/455 (the picture of the model is given below as Figure 1);

Technical Data:

Type of instrument	Automatic gravimetric filling instrument
Working Principle	Strain gauge type load cell based
Accuracy class	X(x) where $x=1$
Maximum filling capacity	500 g/filling head (2 filling Head- Total 1000 g)
Minimum filling capacity	10g
Scale interval (d)	0.1 g
Filling speed	20 to 120 weighing per minute
No.of filling heads	2 (500g each)
No of weighing heads	upto 20
Power Supply	230 V, 50Hz AC
Load Cell	Make: Ishida; Model: TLC-6L, Max Capacity:1000g each ; Accuracy Class: C1
Type of Display	LCD
Software version	PACKAGE P:10367 , WCU: T6538A, DMU:T8677
Checksum	0x4bb580fd

Figure 1


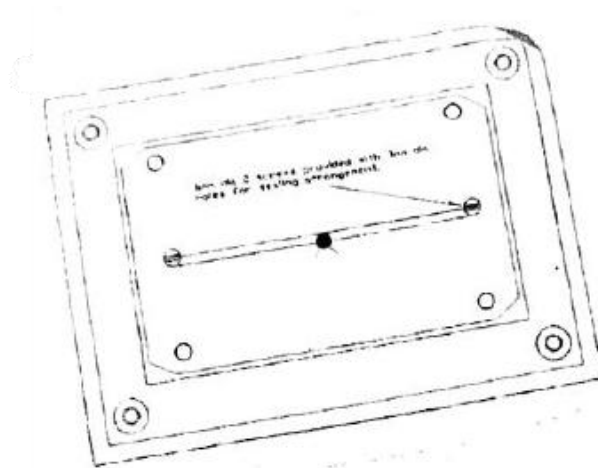


Figure 2

A typical schematic diagram of sealing provision to prevent the fraudulent practices of the model is given above as Figure 2. A dip switch has also been provided in the motherboard/PCB to disable access to external calibration.

[F.No. I-21/294/2026-W&M Section]

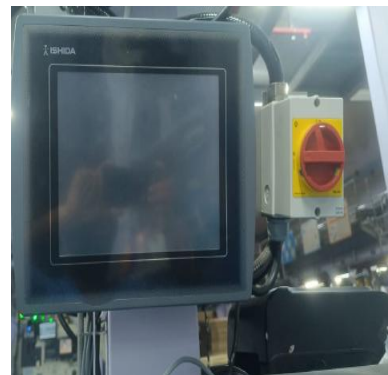

**ASHUTOSH
AGARWAL**

Digitally signed by
ASHUTOSH AGARWAL
Date: 2026.09.28
12:46:26 +05'30'

(Ashutosh Agarwal/आशुतोष अग्रवाल)
Director (Legal Metrology) to Govt. of India/ निदेशक (विधिक माप विज्ञान) भारत सरकार
Phone/दूरभाष: 011-23389489
Email/ई-मेल: dirwm-ca@nic.in