Online Application: 22193

[I-21/228/2026-W&M Section]

GOVERNMENT OF INDIA/भारत सरकार

MINISTRY OF CONSUMER AFFAIRS, FOOD AND PUBLIC DISTRIBUTION

उपभोक्ता मामले, खाद्य एवं सार्वजनिक वितरण मंत्रालय

DEPARTMENT OF CONSUMER AFFAIRS/ उपभोक्ता मामले विभाग

LEGAL METROLOGY DIVISION/ विधिक मापविज्ञान प्रभाग

Krishi Bhawan/कृषि भवन, नई दिल्ली

Dated/दिनांक-: 08.10..2026

Certificate of Approval of Model/ मॉडल का अनुमोदन प्रमाणपत्र

Whereas the Central Government, after considering the report submitted to it by the prescribed authority, is satisfied that the model described in the said report (see the figure given below) is in conformity with the provisions of the Legal Metrology Act, 2009 (1 of 2010) and the Legal Metrology (Approval of Models) Rules, 2011 and the said model is likely to maintain its accuracy over periods of sustained use and to render accurate service under varied conditions;


Now, therefore, in exercise of the powers conferred by the second proviso to section 22 of the Legal Metrology Act, 2009 (1 of 2010) read with sub-rule (6) of rule 8 and sub-rule (4) of rule 11 of the Legal Metrology (Approval of Models) Rules, 2011, as per Schedule Eighth of the Legal Metrology (General) Rules,2011, the Central Government hereby issues the certificate of approval of model of measuring systems for liquids other than water (Fuel Dispenser) with digital indication of accuracy class 0.5 (hereinafter referred to as the said model) of series "MDU PRO" and with brand name "MOBA" manufactured by M/s Moba Mobile Automation(I) Private Limited, B-210/211/212, GIDC, Electronics Estate, Sector 25, Gandhinagar, Gujarat-382024 and which is assigned the approval mark IND/09/26/ 468 (the picture of the model is given below as Figure 1);

Technical Data:

Type of instrument	Fuel dispenser (Mobile Type)
Working Principle	Volume of liquid is measured by the piston type positive displacement meter
Maximum Flow Rate	60 liter per minute
Minimum Flow Rate	20 liter per minute
Accuracy Class	0.5
Minimum Measured Quantity (MMQ)	5 liter
Smallest Division	10 ml
Display/Indication	OLED display, Amount to pay 4 digits for rate
Temperature range	0°C to 50°C
Power supply	12/24 V DC
Totalizer	8-digit electronic totalizer
Software details	Firmware File:02.04.01 Checksum: 4ad658a6180c893a2429da6f63040d0819e4441775c70bc0c178ed3a6e2f306
Calibration	Electronic facility (OTP Protected).

Figure 1



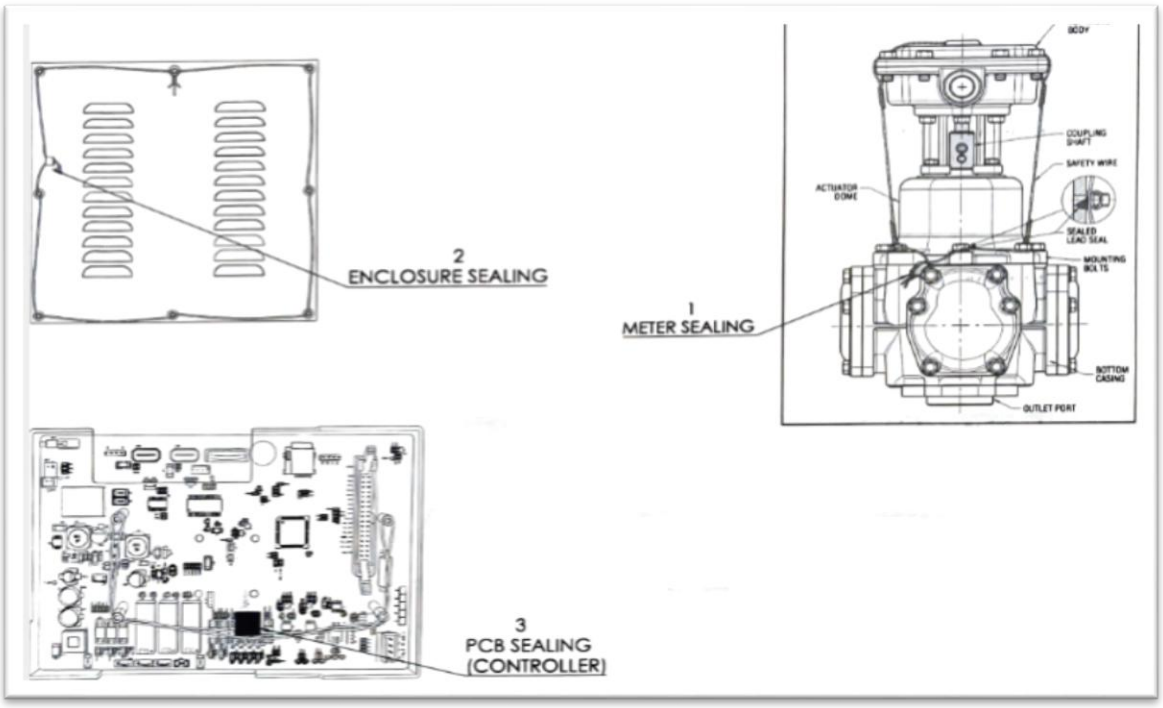

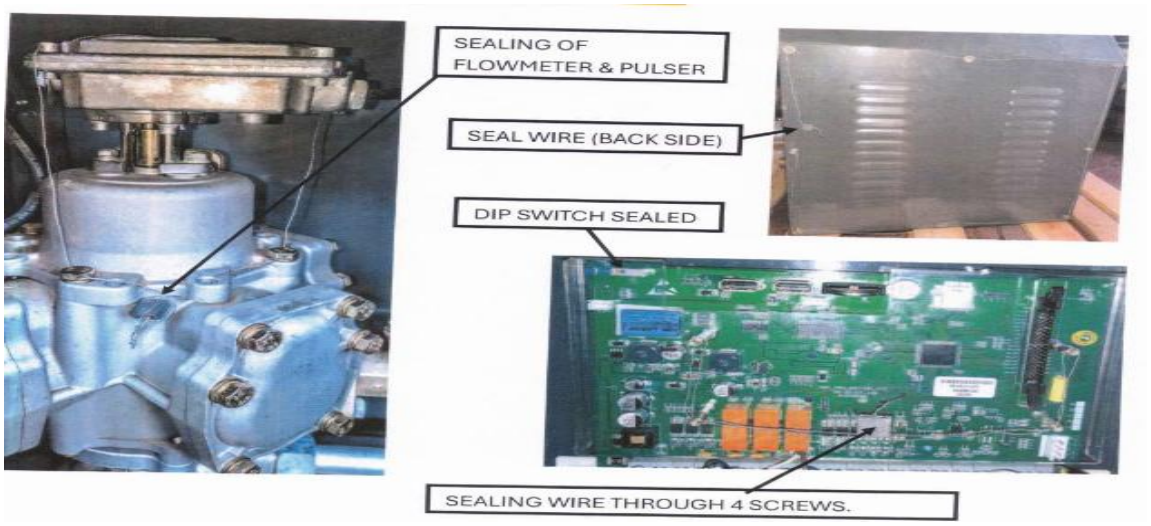


Figure 2.

A typical schematic photograph of sealing provision to prevent the fraudulent practices of the model is given above as Figure 2.

[F.No. I-21/228/2026-W&M]

ASHUTOSH AGARWAL
Digitally signed by ASHUTOSH AGARWAL
Date: 2026.10.08 11:20:21 +05'30'

(Ashutosh Agarwal) / (आशुतोष अग्रवाल)
Director (Legal Metrology)/निदेशक (विधिक माप विज्ञान)
Phone/दूरभाष: 011-23389489
Email/ई-मेल: dirwm-ca@nic.in